


<u> </u>	RIGHT by MEIKO			
1.0	machine connection: drain connection hose, DN 22 hose fitted as odour trap in interior of machine			
1.1	drain (max. 700 mm above finished floor level), DN 50			
2.0	Machine connection: fresh water supply, G 3/4"			
2.2	Soft cold water 10°C, DN 15, G 3/4 a max. 0,54 mmol/I CaCO₃ (max. 3°dH) Flow rate: 5,0 I/min Minimum flow pressure: 60 kPa / 0,6 bar in front of solenoid valve Maximum pressure: 500 kPa / 5,0 bar			
	stopcock and fine screen ≤ 25 μm			
<u>3.0</u> 3.1	Machine connection: electrical connection cable 5G 10mm ² electricity supply to the machine: 3N PE 400V ~ 50Hz nominal current / - capacity: 38,4 A / 22,9 kW Voltage equalising cable			
6.0	The master switch must be provided on site Heat load of warewash area			
0.0	 The values apply for the following room conditions: Room temperature 22 °C, rel. humidity 55 % Recommended suction area according to German EN 16282 or any local regulations have to be observed to determine ventilation of wash areas The total heat load includes 6.1 			
6.1	Heat load of the machine in normal washing operation: for 15 programme cycles/h total 6,7 kW, perceptible 4,5 kW, latent 2,2 kW			
	For the total space load, all other space loads must be considered. The space ventilation must be designed in accordance with EN 16282.			
all cab	les, pipes etc leaving machine 1,8 m			
Mac	hine Equipment			
	<pre></pre> <pre><</pre>			
(A) En	try height			
Final r	inse dosing unit with suction lance (blue connector)			
	ck wall cladding			

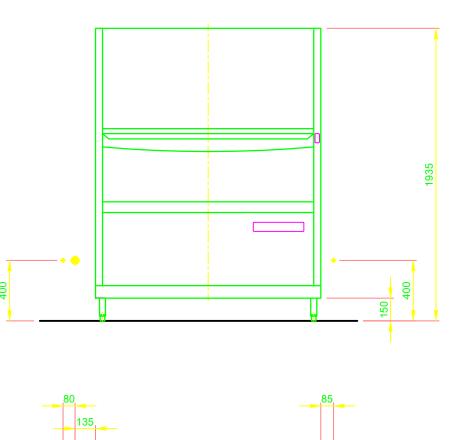

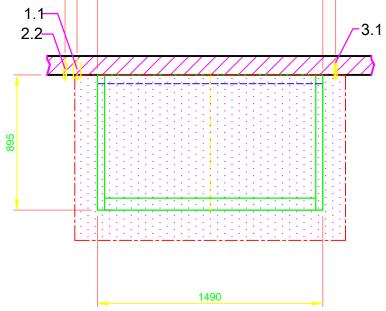

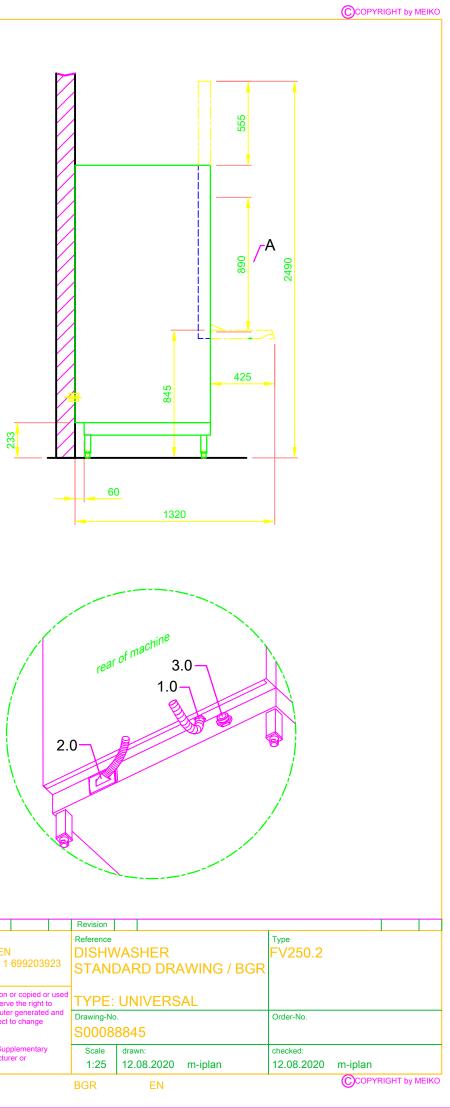

				Revision	
	MEIKO AUSTRIA GMBH HETMANEKGASSE 1B, A-1230 WIEN TEL. +43 1 6992039 TELEFAX +43 1 699203923 E-MAIL: office@meiko.at				
f r i: r	This drawing may not be neither passed to third parties for their information or copied or used for competitive purposes without our consent. All rights reserved. We reserve the right to make changes resulting from technical progress. This drawing was computer generated and is not subject to the checking and any release process; it is also not subject to change management. Please note:				
1	his document is only valid in conjunction with the conditions defined in Sup heet "Important Information". These can be requested from the manufactur ownloaded from the Partnernet.			Scale 1:25	
				BGR	